

5190243IB02

2022050817




Report No: 2022050817
Applicant : **ASD LAMİNAT A.Ş.**
Yeşilköy Mah. Atatürk Cad. İstanbul Dünya Ticaret Merkezi Blokları A1 Blok
No:10/1 K:15 Ofis No: 463-465-466 Bakırköy/İSTANBUL
Contact Person : İsmail Altındal
Contact Telephone : 0212 670 03 60
Contact e-mail : info@asdlaminat.com
Sample Accepted on : 07.07.2022
Test Resulted Date : 05.08.2022
Total number of pages : 6 (Pg)

Sample ID : EGF Kompakt Laminat

	TEST	METHOD	RESULT	
*	Standard Test Method for Surface Burning Characteristics of Building Materials	ASTM E 84-21A	PASS	
			CLASS A	
			FSI	SD
			19	30



Seal



Customer Representative
Merve Nur KIRVELİ



Laboratory Manager
Merve ÖZLÜ

TÜRCERT TEKNİK KONTROL VE BELGELENDİRME A.Ş.

It is prohibited to change any and all versions of this document in any manner whatsoever. In case of a conflict between the electronic version (e.g. PDF file) and the original paper version provided by TÜRCERT®, the latter will prevail.

TÜRCERT Teknik Kontrol ve Belgelendirme A.Ş. disclaim liability for any direct, indirect, consequential or incidental damages that may result from the use of the information or data, or from the inability to use the information or data contained in this document.

The contents of this report may only be transmitted to third parties in its entirety and provided with the copyright notice, prohibition to change, electronic versions' validity notice and disclaimer.

Environment

The requirements and standards apply to equipment intended for use in

X	Residential (domestic) environment
X	Commercial and light-industrial environment
X	Industrial environment
X	Medical environment

ASTM E 84 Standard Test Method for Surface Burning Characteristics of Building Materials

Scope

This standard is used to measure and describe the response of materials, products, or assemblies to heat and flame under controlled conditions, but does not by itself incorporate all factors required for fire-hazard or fire-risk assessment of the materials, products, or assemblies under actual fire conditions.

General

The purpose of this test method is to determine the relative burning behavior of the material by observing the flame spread along the specimen. Flame spread and smoke developed index are reported. However, there is not necessarily a relationship between these two measurements.

Method

This fire-test-response standard for the comparative surface burning behavior of building materials is applicable to exposed surfaces such as walls and ceilings. The test is conducted with the specimen in the ceiling position with the surface to be evaluated exposed face down to the ignition source. The material, product, or assembly shall be capable of being mounted in the test position during the test. Thus, the specimen shall either be self-supporting by its own structural quality, held in place by added supports along the test surface, or secured from the back side.

Summary Of Test Procedure

Upon ignition of the gas burners, the flame spread distance is observed and recorded every second. Flame spread distance versus time is plotted. Calculations ignore all flame front recessions and Flame Spread Index (FSI) is determined by calculating the total area under the curve for the test sample. If the area under the curve (A) is less than or equal to 97.5XA min·ft, then $FSI = 0.515 \cdot A$; if greater, $FSI = 4900 / (195 - A)$. FSI is then rounded to the nearest multiple of 5. Smoke Developed (SD) is determined by dividing the total area under the obscuration curve by that of red oak, and multiplying by 100. SD is then rounded to the nearest multiple of 5 if less than 200. SD values over 200 are rounded to the nearest multiple of 50. Section 5.1.9.1 of ASTM E 84-12c specifies a single combination of lamp and photocell to create the requisite optical system. It is anticipated that alternative, equivalent systems will be permitted in future revisions of the test standard. In May 2012, the Exova tunnel was modified to include a specially-designed optical measurement system that is utilized by many other tunnel systems worldwide. Although an improvement to performance and reliability is realized, as of this date the new system is not specifically recognized by ASTM E 84 so this represents a deviation to the test protocol.

RESULTS

Calculated Flame Spread (CFS)	Rounded Flame Spread Index (FSI)	Calculated Smoke Developed (CSD)	Rounded Smoke Developed Index (SDI)	Max Temperature to Exposure (°F)
19.5	19	29	30	523


Observations of Burning Characteristics

- The sample began to ignite approximately 40 seconds after the test was exposed to fire.
- The front of the flame spread to a maximum distance of 0,2m in about 82 seconds.


Classification:

Class	Flame Spread Index	Smoke Developed Index
A	0 - 25	450 Max
B	26 - 75	450 Max
C	76 - 200	450 Max

FLAME SPREAD INDEX

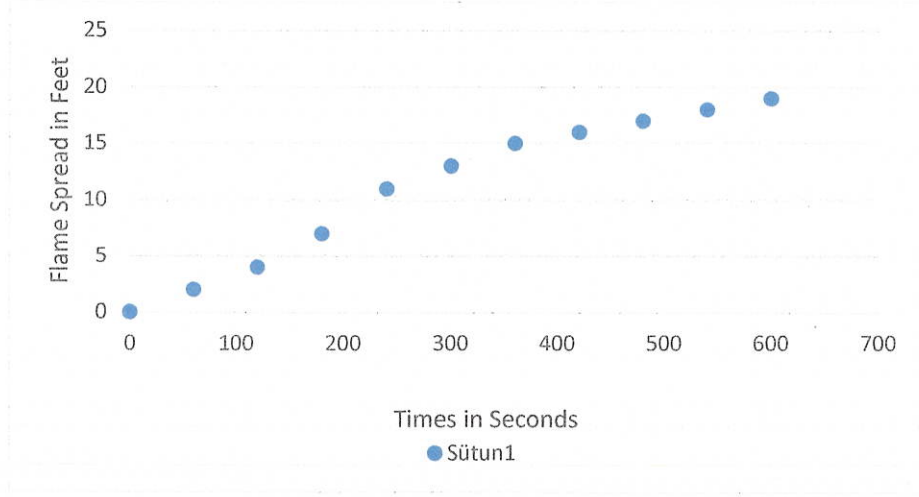

SMOKE DEVELOPED

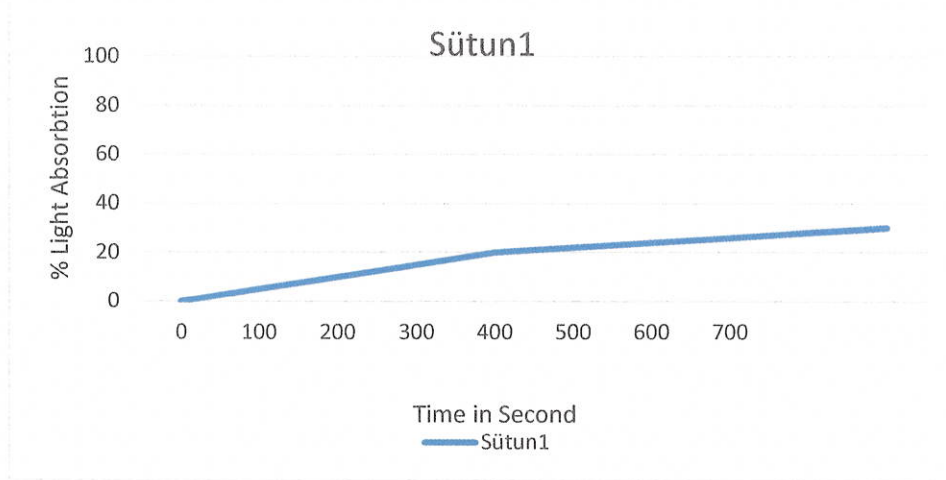

Flame Spread (Index FSI)

19

Smoke Developed (SD)

30

SAMPLE IMAGE



*****End of Report*****